


120 MIN FIRE RATED STEEL DOOR:



TESTED AT CBRI, ROORKEE AS PER BS: 476; PART- 20 & 22

46 mm thick steel Check door of 60/120 minutes Fire rating confirming to BS ;476 Part-22 and IS : 3614 Part-II Fabricated with 2 nos 20 SWG galvanized steel sheet sandwiching with proprietary fire resistant insulation materials in-between. The door frames are manufactured from 16SWG galvanized steel sheet pressed form to double rebate profile of size 143mm x 57mm. The door frame and door shutter are fitted with SS BALL BEARING HINGES (100X75X3MM) and are coated with one coat of fire and corrosion resistant primer. Also available with a finish of Paint finish or Powder coated finish (optional).



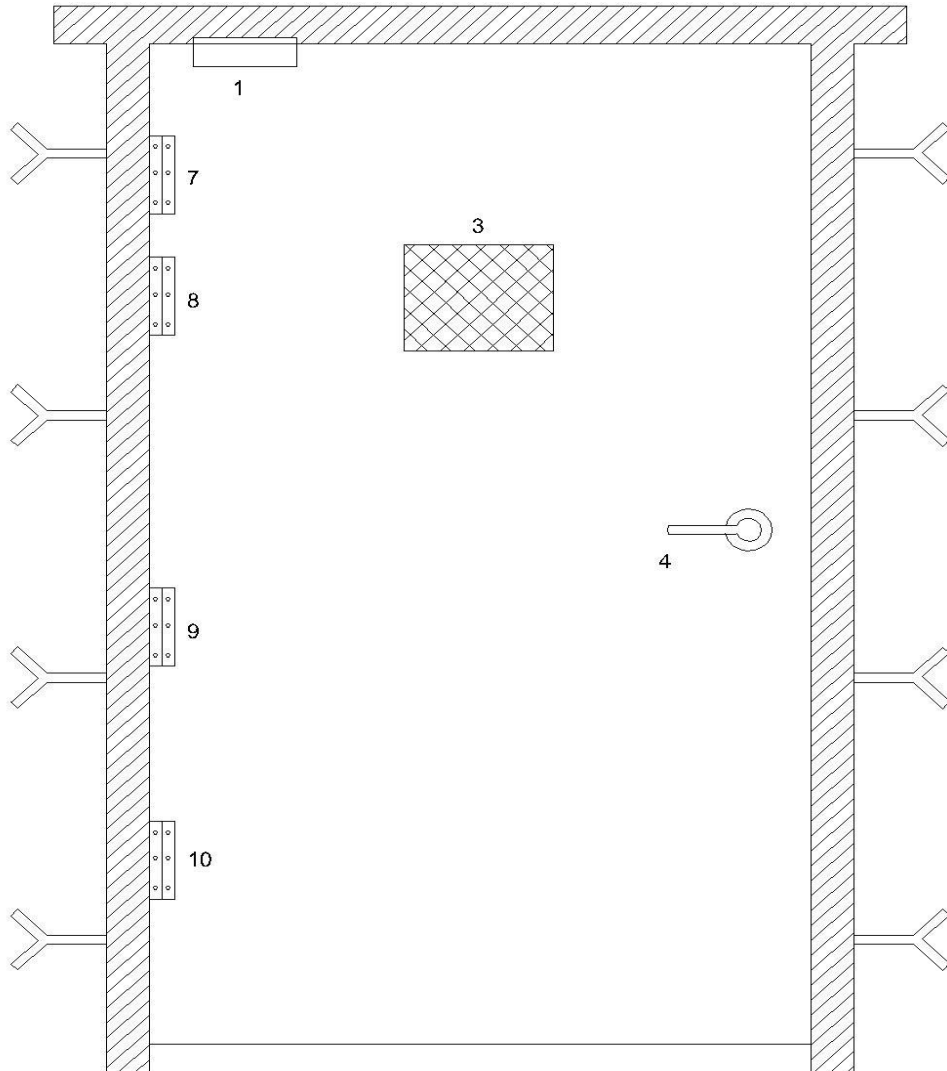

NOTE-

1--DOOR CLOSER

3--VISION PANEL

4--HANDLE

7,8,9,10--HINGES